

Quito, 15 de diciembre de 2017
EPMMQ-GG-1893-2017

Arquitecta
Carla Cevallos
CONCEJALA METROPOLITANA DE QUITO
Municipio de Quito
Presente

*Escrito,
por el Sr.
Ingeniero
Diego Cevallos
19/12/2017*

2017-189147

De mi consideración:

Doy respuesta a las inquietudes manifestadas en su oficio No. 3010-CCR-DMQ y el informe anexo al mismo; para el efecto me permito remitir para el respectivo análisis y verificación las hojas técnicas de los ensayos a carga dinámica según la prueba sísmica ASTM 488-96, así como las especificaciones de definición, identificación y aplicación para la resina de SPIT EPOBAR. Debo recalcar que el análisis para la aprobación de cada uno de los componentes y materiales utilizados en las obras de la Fase 2 de la Primera Línea del Metro de Quito-PLMQ, se realiza en tres etapas: la primera efectuada por el departamento de calidad del Constructor, la segunda por parte del Fiscalizador de las obras, con base en las determinaciones del pliego de especificaciones técnicas del proyecto, y finalmente por parte de la Gerencia de Proyecto, quien procede con la aprobación final de los mismos.

Así también cabe recalcar que de conformidad con los términos del contrato, a más de las consabidas responsabilidades y garantías exigidas al Constructor en una obra de esta naturaleza, le asiste a la entidad Contratante, todas las demás garantías para el caso de obras de infraestructura, establecidas en la normativa ecuatoriana pertinente, en caso de vicios ocultos que se evidenciaren con posteridad a la entrega y operación del Proyecto.

No obstante, siendo este el proyecto de infraestructura urbana más grande del país hasta la fecha, los requisitos del diseño contemplan estrictos criterios de seguridad, basados en las normas técnicas aplicables, que se traducen en sistemas constructivos eficientes, que garantizan la funcionalidad y confort para los usuarios del transporte subterráneo de metro.

Atentamente,



Mauricio Anderson
GERENTE GENERAL
Empresa Pública Metropolitana Metro de Quito

QUITO SECRETARÍA GENERAL DEL CONCEJO
ALCALDÍA RECEPCIÓN

Fecha: 19 DIC 2017 Hora 15:45
Nº HOJAS -16h
Recibido por: 

Anexos

cc: Abogado Diego Cevallos, Secretario General Concejo Metropolitano de Quito




Seismic test according to ASTM 488-96

Product : SPIT EPOBAR

Tests performed on 3 samples, submit to the following load cycles with frequency 2 Hz

Loading cycles in tensile following ASTM 488-96

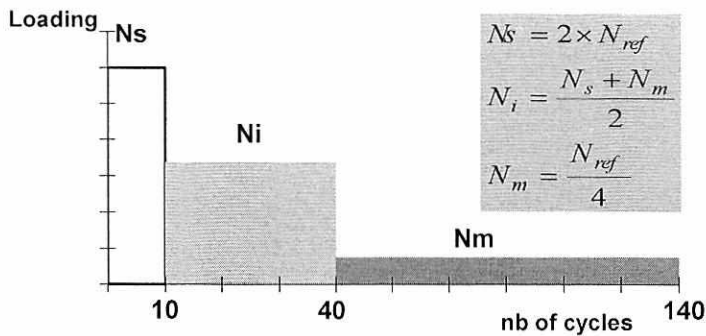

Cycling loading :

During each cycle the load shall change as a sine curve between max N and min N according to the different levels :


- 1st part : 10 cycles sinusoidal $N_s = 29 \text{ kN}$ / $N_{min} = 2,9 \text{ kN}$
- 2nd part : 30 cycles sinusoidal $N_i = 21,7 \text{ kN}$ / $N_{min} = 2,9 \text{ kN}$
- 3rd part : 100 cycles sinusoidal $N_m = 14,5 \text{ kN}$ / $N_{min} = 2,9 \text{ kN}$

After completion of the load cycles the anchor shall be unloaded and a tension test to failure performed.


Residual Tensile test after load cycles					Test result		
Rebar \varnothing	Drilling diameter	Embedment l_s	Test reference	$f_{cm, test}$ Mpa	Nb of samples	$N_{Um}^t(f_{cm, test})$ kN at $d= 1,5 \text{ mm}$	Failure mode
12	15	120	23004M	28,1	3	73,2	Rupture fer

Sample 1 : Displacement measured during applying of cycles load


Displacement value measured after 10 load cycles :

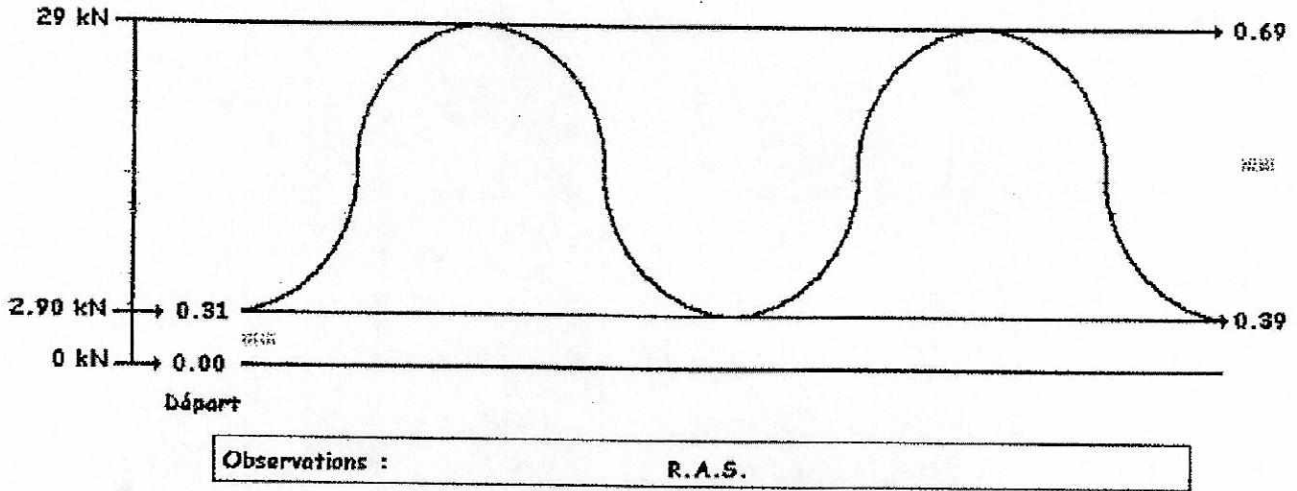

Displacement value measured after 30 load cycles :

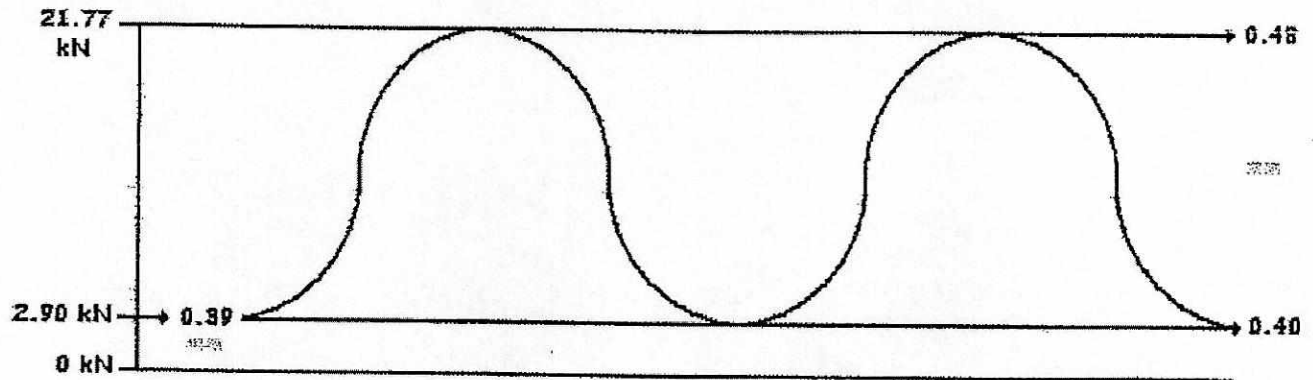


Displacement value measured after 100 load cycles :

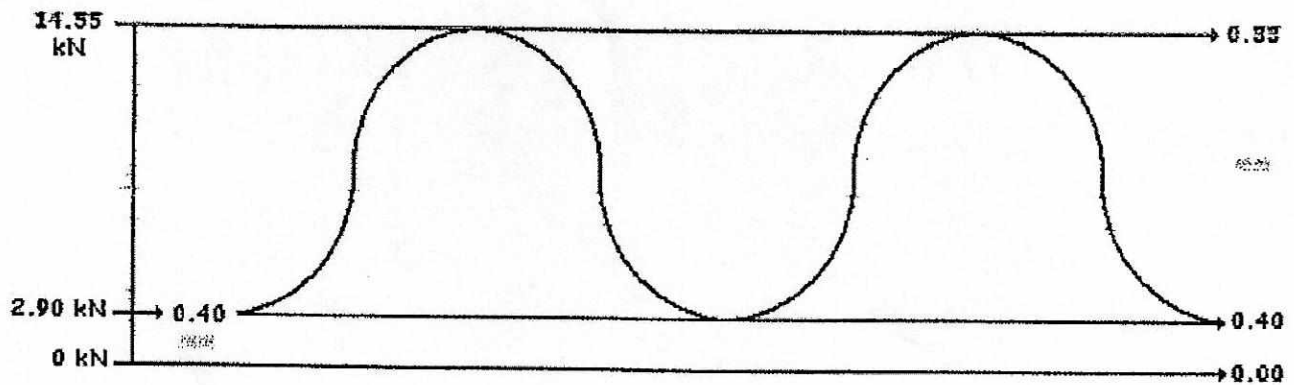


Sample 2 : Displacement measured during applying of cycles load


Displacement value measured after 10 load cycles :

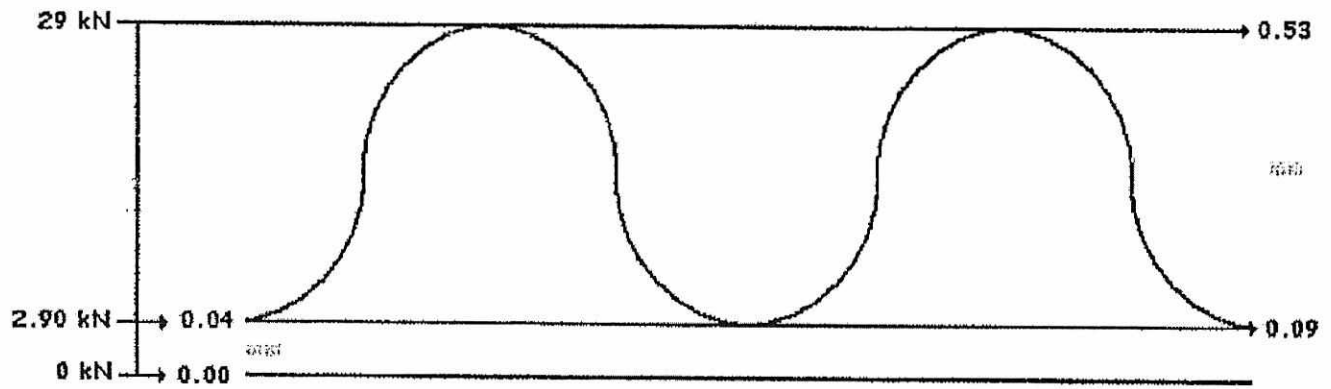

Displacement value measured after 30 load cycles :

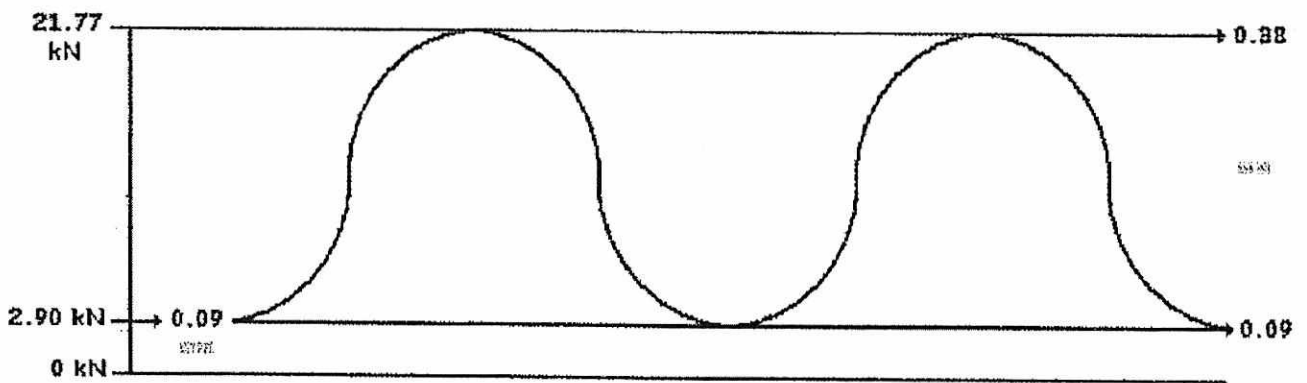


Displacement value measured after 100 load cycles :

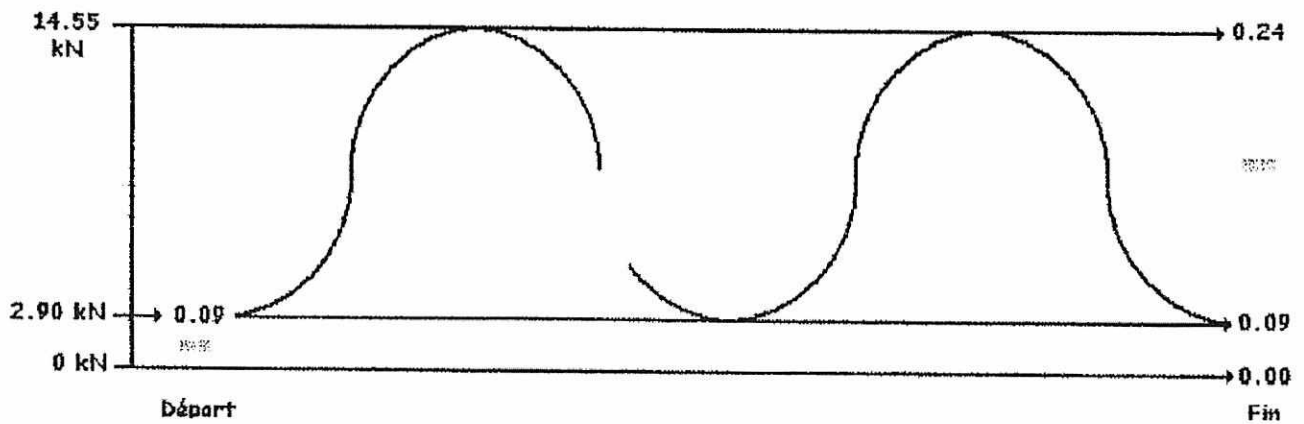


Sample 3 : Displacement measured during applying of cycles load


Displacement value measured after 10 load cycles :

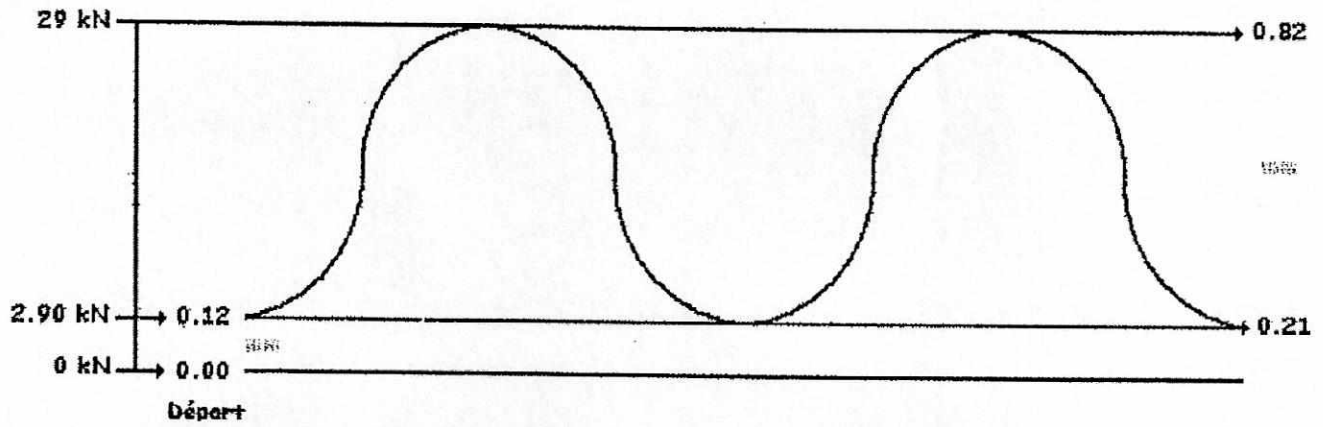

Displacement value measured after 30 load cycles :

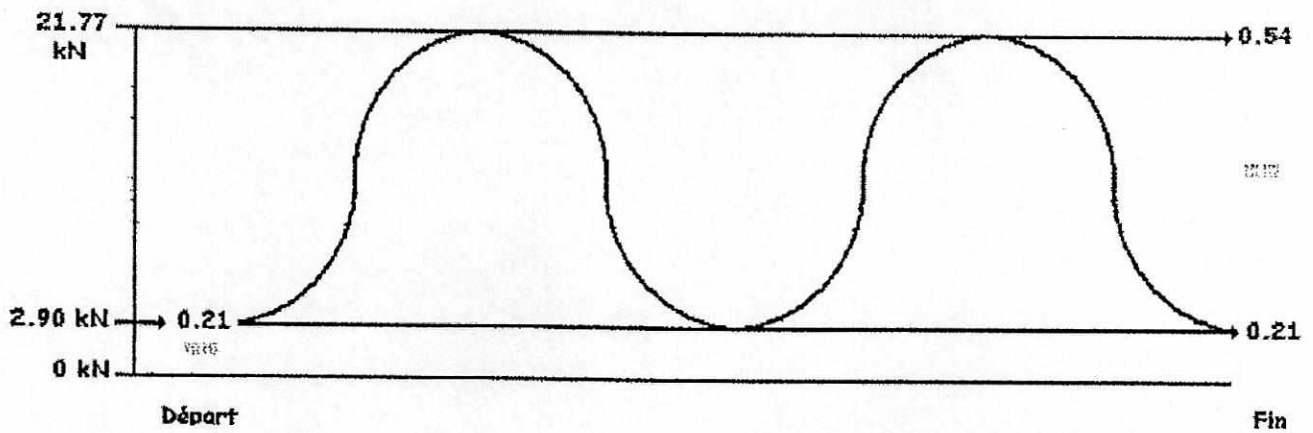

Displacement value measured after 100 load cycles :

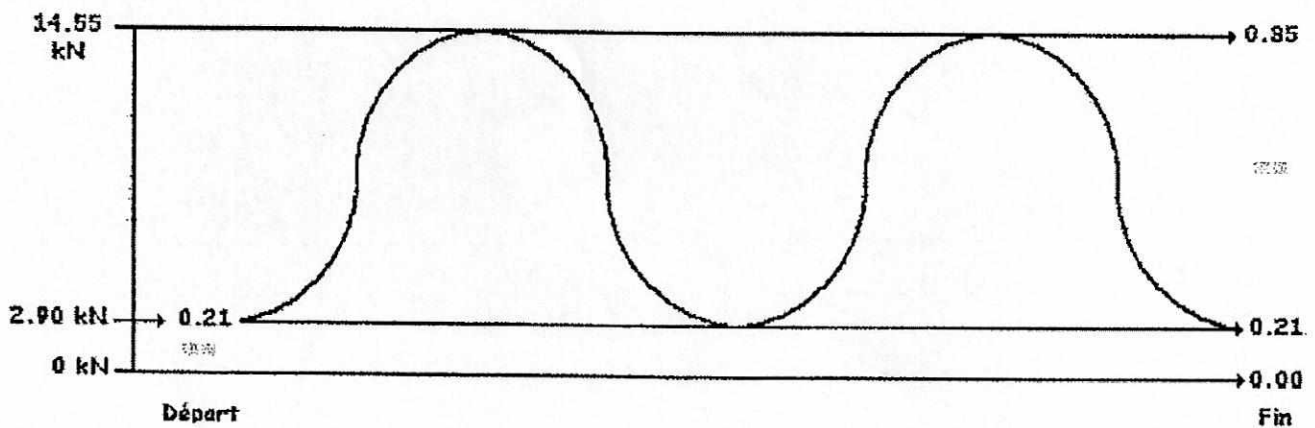

CORPS D'EPREUVE

Béton faible 20-25 MPa
 Dimensions : 0.20x0.20x0.20
 Face exploitée : Dessus
 Date coulée : 26/02/2003
 Date du dernier écrasement : 27/05/2003
 Estimation au jour de l'essai :

Résistance du béton	
f_{cm} (MPa)	N jours
24,7	28
28.1	90
29,6	100
valeur estimée	

PRECISIONS SUR LA FIXATION ESSAYEE

FIXATION ESSAYEE
 EPOBAR
 Type : Armature béton
 REFERENTIEL DE L'ESSAI
 Aucun
 DEFINITION DE L'ESSAI

CONDITIONS DE POSE

Epaisseur pièce à fixer : mm
 Couple de serrage : Nm
 Appuis : Fretté 40 mm

Forêt : Forêt moyen Machine de pose 1 : SPIT 331
 Ø forêt primaire : 15.31 mm Machine de pose 2 : /
 Ø forêt second. : / mm Outil de pose : /
 Entraxe : S₁ : / mm
 S₂ : / mm
 Distances aux bords : C₁ : / mm
 C₂ : / mm

Traction après 24 heures, essai comportement sismiques
 ASTM - 488 - 96
 BETON
 Béton faible
 $\Delta_w = 0$

Acquisition n°	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
Données de pose															
Reperage cheville	1	2	3												
Prof. de perçage (mm)	120	120	120												
Prof. d'ancrage (mm)	120	120	120												
Nbre de coups de marteau à la pose															
Nbre de tours au couple															
Temps à Fmax(s)	141	140	129												

OBSERVATIONS DE POSE

E 08 01 02 20/07/00

FIXATION/ESSAIEE

EPOBAR

Type : Armature béton

REFERENTIEL DE L'ESSAI

Aucun

DEFINITION DE L'ESSAI


0

Traction après 24 heures, essai
comportement sismiques
ASTM - 488 - 96

BETON

Béton faible

$\Delta w = 0$

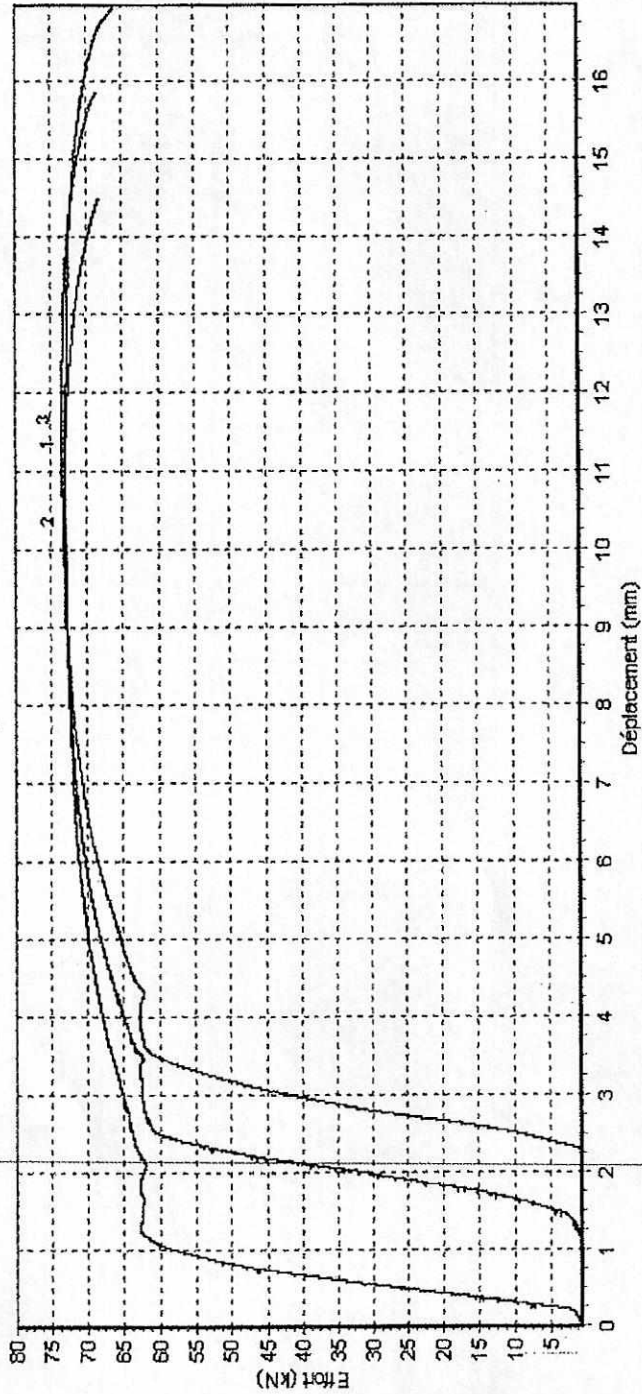

INSTRUMENTATION

Effort	Déplacement	Couple
N° 52 - 100 kN compress°	P1-P2 LPRK	
0,0152 %	+/- 0,017 mm	Nm
FGP N° 53	FGP n° 77	


CEDRE
Laboratoire d'Essais de fixations SPIT
BP 104 - 26 501 Bourg-les-Valence
Tel : 04.75.62.21.24 - Fax : 04.75.42.81.71

Acquisition n°	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	Moyenne	v (%)	OBSERVATIONS
Contrainte adhérence (N/mm ²)	16,13	16,16	16,25													16,18	0,38	
Effort (kN) pour déplacement = 1 mm	58,10	41,22	53,35													50,89	17,11	
Effort (kN) pour dépl. = 1,5 mm.	62,39	61,34	62,42													62,05	0,99	
Effort d'arrachement maxi (kN)	72,98	73,11	73,51													73,20	0,38	
Dépl. à effort maxi (mm)	11,34	9,23	9,42													10,00	11,67	
Type tige	Rupture tige	Rupture tige	Rupture tige															



SPECIFICATION :
DE DEFINITION,
IDENTIFICATION
AND APPLICATION

SPIT EPOBAR

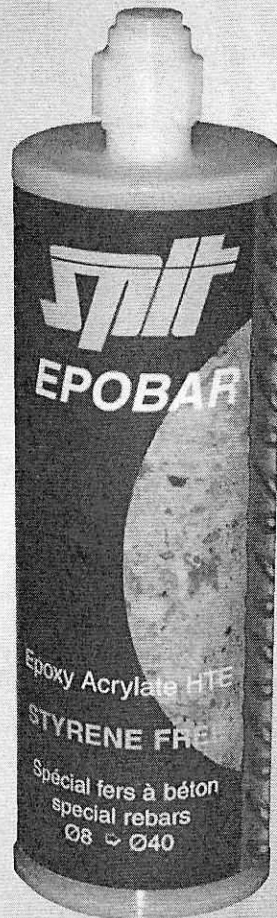

Dimensioning rules
for steel
reinforcement
fixings for concrete
according to
Eurocode 2
regulations

JUNE 2007 – VALIDITY MAY 2010

Accepted by **SOCOTEC**
under No. PX 1117



FOREWORD

■ Concrete

The operating loads which can be applied to anchors generally depend on the mechanical properties of the base material. In the case of concrete, it is customary to refer to its compressive strength.

According to the NF EN 206-1 and EN 1992-1-1 standard, the compressive strength of concrete is expressed in terms of a characteristic resistance defined as being the strength value below which a maximum of 5 % of the whole possible strength measurements of the specified concrete must be located.

The strength must be determined according to ISO 4012 on cubic specimens 15 x 15 x 15 cm (called $f_{ck,cube}$) or a cylindrical specimens 16 x 32 cm (called $f_{ck,cyl.}$) 28 days old, complying with ISO 1920 and manufactured and stored according to ISO 2736.

Concrete is classified according to its compressive strength which is based on the classification per strength measured on cylinders as indicated in the NF EN 206-1 and EN 1992-1-1 standard. For information, the table below gives an equivalence between the characteristic values and average strength on cylindrical and cubic specimens in Mpa.

Classes	Characteristic strength f_{ck}		Average strength		
	Cylinder 16 x 32 cm	Cube 15 x 15 x 15 cm	Cylinder (f_{cm}) 16 x 32 cm	Cube 15 x 15 x 15 cm	Cube 20 x 20 x 20 cm
C 16/20	16	20	20	25	24
♦ C 20/25	20	25	25	31	29
C 25/30	25	30	30	37	36
♦ C 30/37	30	37	37	46	43
C 35/45	35	45	45	56	53
♦ C 40/50	40	50	50	62	59
C 45/55	45	55	55	69	65
♦ C 50/60	50	60	60	72	68

♦ *The most usual classes.*

TABLE OF CONTENTS

FOREWORD

1 – THE EPOBAR RESIN

1.1 – DEFINITION OF THE EPOBAR RESIN

1.1.1 – SPIT EPOBAR cartridges : composition

1.1.2 – Storage conditions

1.1.3 - Marking

1.2 – DESCRIPTION OF THE INJECTION SYSTEM

1.2.1 – Nozzles

1.2.2 – Injection guns

1.2.3 - Cleaning brushes

2 – OPERATING PRINCIPLE

3 – THE APPLICATION FIELD

4 – EPOBAR RESIN PERFORMANCES : TENSILE TESTS ON REBARS

4.1 – Tensile tests on rebars

4.2 – Minimum anchoring depths guaranteeing the failure of steel rebar

4.3 – Bonding strength

4.4 – Behaviour in a wet concrete

5 – CONDITIONS FOR USING SPIT EPOBAR RESIN

5.1 – EPOBAR resin's resistance to temperature

5.2 – Behaviour in water

5.3 – Behaviour under a long-term load

5.3.1 – Reference tests according to the NFP 18 836 standard

5.3.2 – Resistance to long-term loading at + 50°C

5.4 – Behaviour to pulsating loads

5.5 – Seismic behaviour

5.6 – Electric conductivity

5.7 - Resistance of SPIT EPOBAR resin to chemical agents

5.8 - Resistance of SPIT EPOBAR resin in specific atmospheres

6 – DESIGN OF WORKS

6.1 – Mechanical characteristics of rebars

6.2 – Anchoring depth calculation

6.3 - Dimensioning tables of anchoring for concrete according to the EUROCODE 2 rules

7 – CONDITIONS OF USE

7.1 – Installation

7.2 - Curing time before loading


8 – PRODUCTION AND QUALITY ASSURANCE

9 – VALIDITY


1 – THE EPOBAR RESIN

1.1 - Definition of the EPOBAR Resin

1.1.1 – SPIT EPOBAR cartridges : composition

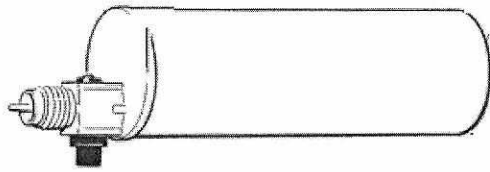

① EPOBAR 410

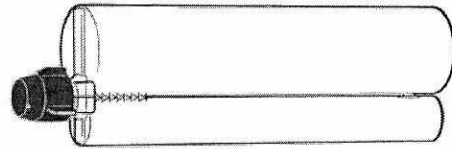

② EPOBAR 910

The EPOBAR resin is composed of two components contained in a two-cylinder monoblock cartridge (these cylinders are concentric ① for EPOBAR 410 and juxtaposed ② for EPOBAR 910) :

- . The large-diameter cylinder contains the VINYLESTER resin ;
- . The small-diameter cylinder contains the hardener.

The table below summarizes the technical characteristic of the components:

	Density g/ml	Viscosity pas	Volume Cm ³		Net Weight g		Ignition Point
			EPOBAR 410	EPOBAR 910	EPOBAR 410	EPOBAR 910	
Vinylester resin	1.59	60	373	827	593	1315	53°C
Hardener	1.59	95	37	83	59	94	93°C
Mixture	-	-	410	910	652	1447	-

The EPOBAR resin's mechanical characteristics after polymerization :

	Polymerized EPOBAR resin
Compressive strength	80 Mpa
Young's modulus	5100 N/mm ²
Shore hardness D	90

1.1.2 – Storage conditions

The cartridges must be stored at temperatures between +5°C and 35°C.

1.1.3 – Marking

The usage limit date is affixed to the cartridge in the following format : DD MM YY.


1.2 – Description of the Injection System

1.2.1 – Nozzles

The CM12L nozzle for the EPOBAR 410 cartridges :




The E910 nozzle for the EPOBAR 910 cartridges + 1 m extension :



Note : The CM12L and E910 nozzles are adapted to the EPOBAR resin in order to obtain a good mixture. The product does not accept other nozzles.

1.2.2 – Injection guns

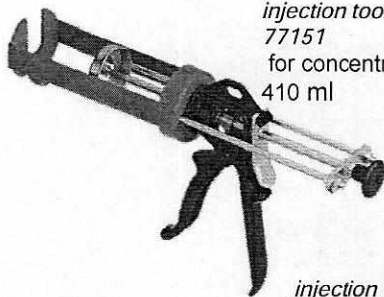

*injection tool 380-410 code 77151
for concentric cartridges vol. 410 ml*




*injection tool 910 code 063750
for coaxial cartridges vol. 910 ml*

These guns consist of a frame and a mechanical system made of steel, a highly ergonomically designed 18 / 1 ratio handle for the 410 gun and 26 / 1 ratio handle for the 910 gun.

The guns benefit from a double guidance.

The blocking tab at the rear allows instantaneously eliminating the resin pressure.

1.2.3 – Cleaning brushes

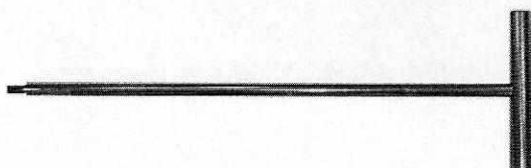

- 10 / 16 / 25 / 30 mm dia. cleaning brush
- 320 mm extension
- 300 mm handle

2 – OPERATING PRINCIPLE

The EPOBAR resin used for the fixing of steel reinforcements in concrete is an injectable resin inserted in the drill hole (~50 % volume) using an injection tool and its nozzle. Thus, by passing through the nozzle, the 2 constituents of the cartridge (vinylester resin + hardener) are mixed to cause a chemical reaction which is going to allow the EPOBAR resin to progressively harden.

Once the resin is injected, the steel rebar is inserted in the drill hole down to the effective anchoring depth. The resin is thus going to be spread around the steel reinforcement and the fixture is then going to adhere to the concrete walls. (see table §7.2 for the installation and complete curing time).

3 – THE APPLICATION FIELD

This Specification applies to the use of the EPOBAR resin in both reinforced or non-reinforced concrete in a floor, wall or ceiling position.

This Specification is intended for the use of the EPOBAR resin in the fixing of steel reinforcements in concrete whose characteristic strength on a 28-day old sample is a minimum 20 Mpa. **The concrete can be dry or wet.**

The EPOBAR resin can be used in cracked or hollow concrete and in other solid building materials, but the values in this Specification cannot be used. Please consult us to define the specific tests to be performed accordingly.

4 – EPOBAR RESIN PERFORMANCES : TENSILE TESTS ON REBARS

4.1 – Tensile Tests on Rebars

Pull out tests in a dry and wet environment according to the NFP 18-831 standard allowed validating the use of the EPOBAR resin for the fixing of reinforcements.

On the other hand, creep tests on wet concrete were carried out according to the test methodology of the NFP18-836 standard, and satisfied the criteria of the NFP18-822 standard. (see § 5.3.1).

4.2 – Minimum Anchoring Depths Guaranteeing the failure of Steel rebar

The minimum anchoring depths were experimentally determined in order to obtain a minimum failure load according to the NFA 35016 standard. The minimum drill hole diameters were determined in order to obtain a free introduction of the steel rebars into the drilled hole.

The table below gives the results obtained for the failure of the steel rebar Fe E500 (mm) (confined tests).

Steel rebar \varnothing	8	10	12	14	16	20	25	32	40
Drill hole \varnothing	10 - 12	12 - 15	15 - 18	18 - 20	20 - 24	25 - 28	30 - 32	40	50
Anchoring depth (mm) for $f_{ck} \geq 20$ Mpa	60	80	100	110	130	160	190	250	250
Failure load (daN) for $f_{ck} \geq 20$ Mpa	3030	4850	6985	9000	12700	18500	31200	50000	65957
Conventional elasticity limit (daN)	2515	3925	5650	7700	10050	15700	24550	40200	62850

The anchoring depths specified above allow judging the resin's performances, but cannot be used for the design of the anchoring. The dimensioning rules defined in §6 have to be applied.

4.3 – Bonding strength

The **characteristic bonding strength** was determined from all the tests performed at a reduced depth, allowing to obtain a bond failure ($\sim 6 \times \varnothing$ steel-bar) in a concrete of the C20/25 class.

Its value is **17.85 N/mm²** for steel bar diameters varying from 8 to 40 mm.

4.4 – Behaviour in a wet concrete

The test results presented below highlight the fact that the EPOBAR resin is hardly sensitive to wet drilling conditions

Test conditions	Steel rebar Ø mm	Drill hole Ø mm	Anchoring depth mm	Failure load (daN) for $f_{ck} \geq 20$ Mpa	Conventional elasticity limit daN
Wet	12	15	120	7370	5650

The results obtained demonstrate that we obtain the failure rebar for the steel bar having a anchoring length equal to $10 \times \text{Ø}_{\text{steel-bar}}$ in a wet environment. These drilling conditions in a wet environment therefore remain acceptable in order to apply the dimensioning rules of the EUROCODE 2.


The EPOBAR resin is waterproof and adapted for a usage in a wet environment.

Note : In compliance with the procedure defined in the Guideline for European Technical Approval (ETAG), Part 5, untitled "Bonded anchors", the concrete was saturated with water by flooding the drill hole for 8 hours such that the water infiltrated the concrete. For the wet test, the water is swept out of the hole.

5 – CONDITIONS FOR USING SPIT EPOBAR RESIN

5.1 - EPOBAR Resin's Resistance to Temperature

Temperature tests were carried out from 20°C up to 140°C according to the requirements of the ETAG Guide, Part 5 untitled "Bonded anchors" (March 2001 Edition). For the various tested temperatures, pull out tests were conducted after the anchoring had been exposed in an oven at a constant temperature for 24 hours. The influence of the temperature is represented by the following graph :

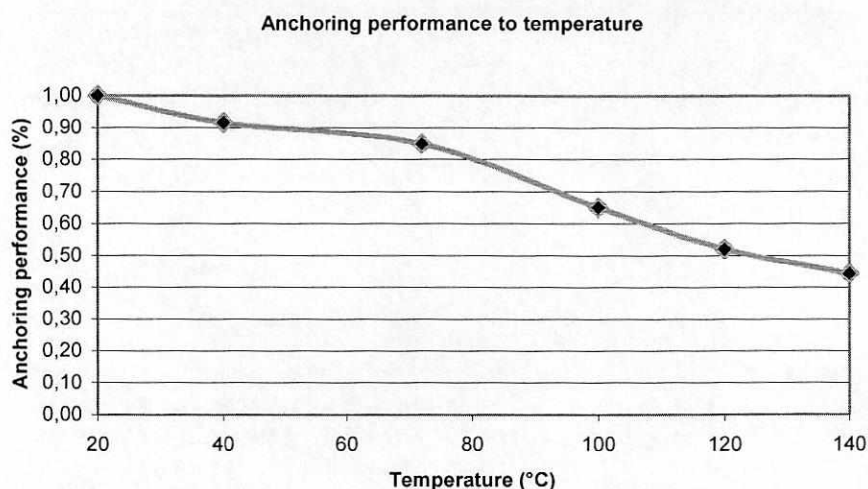

5.2 – Behaviour in water

Tests in a wet environment such as defined in the ETA Guide, Part 5 untitled "Bonded anchors" (March 2001 Edition) were carried out (see §4.4). The results obtained revealed an excellent behaviour by the resin on wet supports. The dimensioning rules according to the EUROCODE 2 in §6 are applicable.

5.3 – Behaviour under a Long-Term Load

5.3.1 – Reference tests according to the NFP 18 836 standard

Creep tests in an humid base material were conducted in compliance with the NFP 18836 standard. The SPIT EPOBAR resin exhibited an excellent behaviour since small displacements with stability over time were observed and a residual load having attained the failure of the steel rebar. The results obtained were compliant with the criteria of the NFP 18822 standard (NF marking requirements).

5.3.2 – Resistance to long-term loading at + 50°C


Creep tests were carried out in an oven at a temperature of 50°C for 2 months. The SPIT EPOBAR resin exhibited an excellent behaviour since small displacements between 0.7 and 0.95 mm with stabilization over time were observed and a residual load greater than the reference value was obtained. The test results obtained allow guaranteeing the dimensioning rules specified in §6.

5.4 – Behaviour to pulsating loads

Tests with pulsating loads were carried out for the EPOBAR sealing of M10 sizes. The sealing was subjected to 10^5 load cycles ; these load variations did not have any effect on the "pin".

5.5 – Seismic behaviour

The EPOBAR resin's behaviour to earthquakes was checked based on the test standard ASTM 488-96. The test procedure consists of applying 140 load cycles at a frequency of 2 Hz in order to simulate seismic stress forces. The following tensile cycles were applied to the anchoring in an uncracked C20/25 concrete :

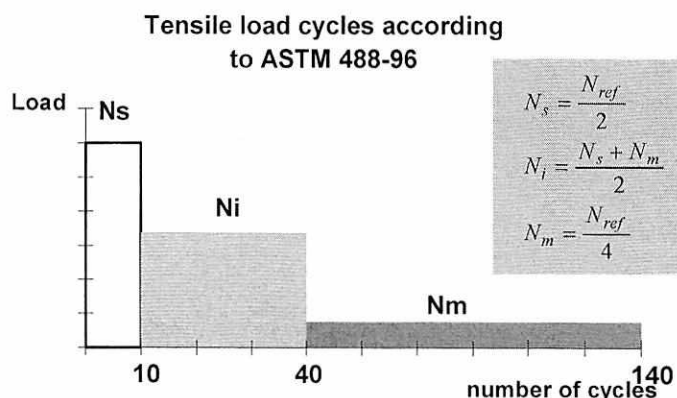

Tests were carried out on a 12 mm dia. steel bar.

The standard's requirements were achieved :

- No anchoring failure during the load cycles ;
- Stabilized displacements ;
- Failure load equal to the reference value after application of the cycles

5.6 – Electric Conductibility

Electric conductivity tests were carried out in the LCIE laboratory in compliance with the IEC standards 60243-1 and 60093 :

- Volume resistivity at 23°C – 50% RH : **$2.8 \times 10^{14} \Omega m$**
- Relative permittivity at 23°C – 50% RH – 50 Hz / 1000 Hz / 10^6 Hz : **4**
- Dielectric strength at 23°C – 50% RH – 50 Hz : **10.1 kN/mm** determined from a 3 mm thick sample.

5.7 - Resistance of SPIT EPOBAR resin to Chemical Agents

Chemical resistance was determined by exposing the resin samples to an attack by various substances. The samples resistance was determined by a visual inspection and classified into 3 states (resistant, sensitive, non resistant).

The various tested substances and the resistance of the SPIT EPOBAR mortar are given in **Appendix 1**.

5.8 - Resistance of the SPIT EPOBAR resin in specific atmospheres

Mortar endurance tests in different environments were carried out according to the ATE Guide, Part 5 untitled "Bonding anchors" (March 2001 Edition) in order to check the influence of these environments on the adherence force's resistance. The following environments were tested :

- . Immersed in a high alkalinity solution (pH = 13.2) for 2000 hours ;
- . Sulfurous atmosphere for 80 cycles alternating 8 hours in a sulfur dioxide atmosphere and 16 hours in a laboratory environment. The sulfur dioxide atmosphere corresponds to the introduction of 0.67% in SO₂ in an atmosphere at 40°C – 100 % RH ; therefore, sulphuric acid is created when in contact with the resin.

The results obtained for these endurance tests allowed guaranteeing the mortar's adherence resistance was not adversely affected by each of the atmospheres.

6 – DESIGN OF WORKS

6.1 – Mechanical Characteristics of rebars

The mechanical characteristics of the high adhesion rebars are defined in the NFA 35-016 and NFA 35-017 standards .

Nominal steel bar \varnothing		8	10	12	14	16	20	25	32	40
Sections (cm ²)		0.503	0.785	1.13	1.54	2.01	3.14	4.91	8.04	12.57
Min. resistances to failure (daN)	Fe E400	2113	3297	4746	6468	8442	13188	20622	33768	52794
	Fe E500	2590	4043	5820	7931	10352	16171	25287	41406	64736
Ultimate limit load (daN)	Fe E500	2185	3415	4917	6693	8742	13659	21343	34956	54636

6.2 – Anchoring Depth calculation

Considering the hypothesis proved during the tests that the ultimate bonding strength of resin with versus concrete is at least equal to the one of high adhesion rebar in concrete, we can apply the formulas given in EUROCODE 2 – defined in the European Standard EN 1992-1-1 April 2004 (§8.4.3).

The anchorage depth L_b (mm) for the ultimate limit load for rebar N_{RD} (N) is given by following equation ::

$$L_b = \frac{\varnothing_t}{4} \cdot \left(\frac{f_{yd}}{f_{bd}} \right)$$

\varnothing_t : Drill hole diameter for the $\varnothing_{\text{steel-bar}}$ considered (mm)

f_{yd} : Elastic limit of rebar in N/mm²

$$f_{bd} = 2,25 \cdot \eta_1 \cdot \eta_2 \cdot f_{ctd}$$

f_{bd} : Design values of the ultimate bond resistance (N/mm²)

$$f_{ctd} = \frac{f_{ctk5\%}}{\gamma_c}$$

f_{ctd} : Design tensile strength of concrete (N/mm²)

η_1 : depends on bond conditions
 $\eta_1 = 1$ (good bond conditions)
 see § 8.4.2 (EN 1992-1-1)

$f_{ctk 5\%}$: Characteristic tensile strength of concrete in N/mm².

η_2 : depends on rebar diameter
 $\eta_2 = 1$ for $\varnothing_{\text{bar}} \leq 32$ mm
 $\eta_2 = 0,92$ for $\varnothing_{\text{bar}} = 40$ mm

γ_c : Safety partial factor equal to 1,5

$$N_{RD} = A_s \cdot f_{yd}$$

N_{RD} : Maximum ultimate limit load for rebar (N)

$$f_{yd} = \frac{f_{yk}}{1,15}$$

A_s : Nominal cross section of rebar (mm²)

So for a design ultimate load $F_{Rd} (\leq N_{Rd})$, The anchorage depth L_s is given by the following equation :

$$L_s = F_{Rd} \times \frac{\varnothing_t}{4} \cdot \left(\frac{f_{yd}}{f_{bd}} \right) \times \frac{1}{A_s \cdot f_{yd}} = F_{Rd} \times \frac{\varnothing_t}{4} \cdot \left(\frac{f_{yd}}{2,25 \cdot \eta_1 \cdot \eta_2 \cdot \frac{f_{ctk5\%}}{\gamma_c}} \right) \times \frac{1}{\left(\frac{\Pi \cdot \varnothing_t^2}{4} \right) \cdot f_{yd}} = \frac{1}{1,5 \cdot \eta_1 \cdot \eta_2 \cdot \Pi} \times \frac{F_{Rd}}{\varnothing_t \cdot f_{ctk5\%}}$$

After simplification , we obtain:

$$L_s \sim \frac{F_{Rd}}{4,71 \cdot \eta_1 \cdot \eta_2 \cdot \varnothing_t \cdot f_{ctk5\%}}$$

With $\eta_1 = 1$ in good bond conditions.

In the opposite case, $\eta_1 = 0,7$ (see §8.4.2 - EN 1992-1-1 Standard, for more details).

$\eta_2 = 1$ for $\varnothing_{bar} \leq 32$ mm

$\eta_2 = 0,92$ for $\varnothing_{bar} = 40$ mm

Concrete strength class	f_{ck} (Mpa)	$f_{ctk5\%}$ (Mpa)
C20/25	20	1,5
C25/30	25	1,8
C30/37	30	2,0
C35/45	35	2,2
C40/50	40	2,5
C45/55	45	2,7

(Concrete strength classes are described in page 1)

Limit of this formula :

- An installation reduced to $10 \times \varnothing_{steel-bar}$ (≥ 100 mm) is possible for a reduced ultimate load of the rebar in compliance with EUROCODE 2.

6.3 – Dimensioning tables of anchoring for Concrete According to the EUROCODE 2 Rules

These tables indicate the values obtained from the application of the formula determined in §6.2 taking into account the limit of use. (Calculation hypothesis $\eta_1 = 1$)

They give the anchoring depth and the number of HA Fe E500 rebar anchoring with EPOBAR 410 and 910 cartridges for the maximum possible ultimate limit load of the rebar or an ultimate limit load below the maximum ultimate load.

The ultimate loads in the tables below represent the calculation resistances to the Ultimate Limit State for the combinations of basic actions (non accidental).

6.3.1 - SPIT EPOBAR Resin - C20/25 Class Concrete ($f_{ck} = 20 \text{ Mpa}$)

Steel bar \varnothing (mm)	Drill hole \varnothing d_0 (mm)	Anchorage Length (mm) L_s	Ultimate limit load (daN)	No. of sealings for a 410 ml cartridge *	No. of sealings for a 910 ml cartridge *
8	10	100	707	116	257
		160	1131	73	161
		250	1767	46	103
		309	2185	38	83
	12	100	848	52	116
		145	1230	36	80
210		1781	25	55	
258		2185	20	45	
10	12	100	848	95	211
		210	1781	45	100
		320	2714	30	66
		403	3415	24	52
	14	100	990	44	97
		190	1880	23	51
		280	2771	16	34
		345	3415	13	28
12	15	120	1272	43	95
		245	2598	21	47
		365	3870	14	31
		464	4917	11	25
	18	120	1527	19	43
		215	2736	11	24
		310	3944	7	17
		386	4917	6	13
14	18	140	1781	23	52
		280	3563	12	26
		420	5344	7.8	17
		526	6693	6.2	14
	20	140	1979	15	32
		260	3676	7.9	17
		380	5372	5.4	12
		473	6693	4.3	10
16	20	160	2262	18	40
		285	4029	10.2	23
		530	7493	5.5	12
		618	8742	4.7	10
	24	160	2714	8.2	18
		290	4920	4.5	10
		420	7125	3.1	7
		515	8742	2.5	6
20	25	200	3534	9.3	21
		405	7157	4.6	10
		610	10780	3.0	7
		773	13659	2.4	5
	28	200	3958	5.4	12
		380	7521	2.9	6
		560	11084	1.9	4
		690	13659	1.6	3
25	30	250	5301	6.1	13
		465	9861	3.3	7
		680	14420	2.2	5
		900	3538	1.7	4
	32	250	5655	4.2	9
		465	10518	2.3	5
		680	15381	1.5	3
		900	20358	1.2	3
32	40	320	9048	2.3	5
		510	14420	1.4	3
		700	19792	1.0	2
		900	25447	0.8	2
40	50	400	13006	1.2	3
		565	18371	0.8	2
		730	23736	0.6	1
		900	29264	0.5	1

* : with 20% loss

SPIT EPOBAR Specification
Fixing of steel reinforcements in concrete
According to EUROCODE 2

Accepted by SOCOTEC under no. PX1117

6.3.2 - SPIT EPOBAR Resin - Class Concrete C25/30 ($f_{ck} = 25 \text{ Mpa}$)

Steel bar \varnothing (mm)	Drill hole \varnothing d_0 (mm)	Anchorage Length (mm) L_s	Ultimate limit load (daN)	No. of sealings for a 410 ml cartridge *	No. of sealings for a 910 ml cartridge *
8	10	100	848	116	257
		150	1272	77	172
		215	1824	54	120
		258	2185	45	100
	12	100	1018	52	116
		130	1323	40	89
		180	1832	29	64
		215	2185	24	54
10	12	100	1018	95	211
		190	1934	50	111
		280	2850	34	75
		336	3415	28	63
	14	100	1188	44	97
		170	2019	26	57
		245	2909	18	39
		288	3415	15	34
12	15	120	1527	43	95
		220	2799	23	52
		320	4072	16	36
		386	4917	13	30
	18	120	1832	19	43
		200	3054	12	26
		275	4199	8	19
		322	4917	7	16
14	18	140	2138	23	52
		250	3817	13	29
		365	5573	8.9	20
		438	6693	7.4	17
	20	140	2375	15	32
		240	4072	8.5	19
		330	5598	6.2	14
		395	6693	5.2	12
16	20	160	2714	18	40
		300	5089	9.7	21
		430	7295	6.7	15
		515	8742	5.6	12
	24	160	3257	8.2	18
		260	5293	5.0	11
		360	7329	3.6	8
		429	8742	3.0	7
20	25	200	4241	9.3	21
		370	7846	5.0	11
		535	11345	3.5	8
		644	13659	2.9	6
	28	200	4750	5.4	12
		340	8075	3.2	7
		485	11519	2.2	5
		575	13659	1.9	4
25	30	250	6362	6.1	13
		465	11833	3.3	7
		680	17304	2.2	5
		839	21343	1.8	4
	32	250	6786	4.2	9
		450	12215	2.3	5
		650	17643	1.6	4
		786	21343	1.3	3
32	40	320	10857	2.3	5
		510	17304	1.4	3
		700	23750	1.0	2
		900	30536	0.8	2
40	50	400	15607	1.2	3
		565	22045	0.8	2
		730	28484	0.6	1
		900	35117	0.5	1

* : with 20% loss

6.3.3 - SPIT EPOBAR Resin - Class Concrete C30/37 ($f_{ck} = 30 \text{ Mpa}$)

Steel bar \varnothing (mm)	Drill hole \varnothing d_0 (mm)	Anchorage Length (mm) L_s	Ultimate limit load (daN)	No. of sealings for a 410 ml cartridge *	No. of sealings for a 910 ml cartridge *
8	10	100	942	116	257
		135	1272	86	197
		190	1791	67	136
		232	2185	50	111
	12	100	1131	52	116
		120	1357	44	97
		160	1810	33	72
		193	2185	27	60
10	12	100	1131	95	211
		170	1923	56	124
		250	2827	38	84
		302	3415	31	70
	14	100	1319	44	97
		160	2111	27	60
		215	2837	20	45
		259	3415	17	37
12	15	120	1696	43	95
		200	2827	26	57
		285	4029	18	40
		348	4917	15	33
	18	120	2036	19	43
		180	3054	13	29
		245	4156	9	21
		290	4917	8	18
14	18	140	2375	23	52
		230	3902	14	31
		325	5513	10.0	22
		395	6693	8.3	18
	20	140	2639	15	32
		220	4147	9,3	21
		300	5655	6,8	15
		355	6693	5,8	13
16	20	160	3016	18	40
		270	5089	10.7	24
		380	7163	7.6	17
		464	8742	6.3	14
	24	160	3619	8.2	18
		245	5542	5,3	12
		330	7464	4,0	9
		386	8742	3,4	7
20	25	200	4712	9.3	21
		340	8011	5.5	12
		480	11310	3.9	9
		580	13659	3.2	7
	28	200	5278	5.4	12
		315	8313	3,5	8
		430	11347	2,5	6
		518	13659	2,1	5
25	30	250	7069	6.1	13
		430	12158	3.5	8
		620	17530	2.4	5
		755	21343	2.0	4
	32	250	7540	4.2	9
		420	12667	2.5	6
		585	17643	1.8	4
		708	21343	1.5	3
32	40	320	12064	2.3	5
		510	19227	1.4	3
		700	26389	1.0	2
		900	33929	0.8	2
40	50	400	17342	1.2	3
		565	24495	0.8	2
		730	31648	0.6	1
		900	39019	0.5	1

* : with 20% loss

SPIT EPOBAR Specification
Fixing of steel reinforcements in concrete
According to EUROCODE 2

Accepted by SOCOTEC under no. PX1117

6.3.4 - SPIT EPOBAR Resin - Class Concrete C35/45 ($f_{ck} = 35$ Mpa)

Steel bar \varnothing (mm)	Drill hole \varnothing d_0 (mm)	Anchorage Length (mm) L_s	Ultimate limit load (daN)	No. of sealings for a 410 ml cartridge *	No. of sealings for a 910 ml cartridge *
8	10	100	1037	116	257
		125	1296	93	206
		170	1762	68	151
		211	2185	55	122
	12	100	1244	52	116
		115	1431	45	101
		150	1866	35	77
		176	2185	30	66
10	12	100	1244	95	211
		160	1991	59	132
		220	2737	43	96
		275	3415	35	77
	14	100	1451	44	97
		150	2177	29	64
		195	2830	22	50
		235	3415	18	41
12	15	120	1866	43	95
		190	2955	27	60
		260	4043	20	44
		316	4917	16	36
	18	120	2239	19	43
		170	3172	14	30
		225	4199	10	23
		263	4917	9	20
14	18	140	2613	23	52
		215	4012	15	34
		300	5598	10.9	24
		359	6693	9.1	20
	20	140	2903	15	32
		205	4251	10.0	22
		270	5598	7.6	17
		323	6693	6.3	14
16	20	160	3318	18	40
		250	5184	11.6	26
		345	7153	8.4	19
		422	8742	6.9	15
	24	160	3981	8.2	18
		230	5723	5.7	13
		300	7464	4.4	10
		351	8742	3.7	8
20	25	200	5184	9.3	21
		315	8164	5.9	13
		430	11145	4.3	10
		527	13659	3.5	8
	28	200	5806	5.4	12
		295	8563	3.7	8
		400	11611	2.7	6
		471	13659	2.3	5
25	30	250	7775	6.1	13
		405	12596	3.7	8
		560	17417	2.7	6
		686	21343	2.2	5
	32	250	8294	4.2	9
		390	12938	2.7	6
		530	17583	2.0	4
		643	21343	1.6	4
32	40	320	13270	2.3	5
		505	20942	1.4	3
		690	28614	1.1	2
		843	34956	0.9	2
40	50	400	19076	1.2	3
		565	26944	0.8	2
		730	34813	0.6	1
		900	42920	0.5	1

* : with 20% loss

6.3.5 - SPIT EPOBAR Resin - Class Concrete C40/50 ($f_{ck} = 40 \text{ Mpa}$)

Steel bar \varnothing (mm)	Drill hole \varnothing d_0 (mm)	Anchorage Length (mm) L_s	Ultimate limit load (daN)	No. of sealings for a 410 ml cartridge *	No. of sealings for a 910 ml cartridge *
8	10	100	1178	116	257
		120	1414	97	215
		160	1885	73	161
		185	2185	63	139
	12	100	1414	52	116
		110	1555	47	105
		135	1909	39	86
		155	2185	34	75
10	12	100	1414	95	211
		150	2121	63	140
		205	2898	46	103
		242	3415	39	87
	14	100	1649	44	97
		140	2309	31	69
		180	2969	24	54
		207	3415	21	47
12	15	120	2121	43	95
		180	3181	29	64
		240	4241	21	48
		278	4917	19	41
	18	120	2545	19	43
		160	3393	15	32
		200	4241	12	26
		232	4917	10	22
14	18	140	2969	23	52
		205	4347	16	35
		270	5726	12.1	27
		316	6693	10.3	23
	20	140	3299	15	32
		195	4595	10.5	23
		250	5890	8.2	18
		284	6693	7.2	16
16	20	160	3770	18	40
		240	5655	12.1	27
		315	7422	9.2	20
		371	8742	7.8	17
	24	160	4524	8.2	18
		215	6079	6.1	13
		270	7634	4.8	11
		309	8742	4.2	9
20	25	200	5890	9.3	21
		300	8836	6.2	14
		395	11634	4.7	10
		464	13659	4.0	9
	28	200	6597	5.4	12
		280	9236	3.9	9
		360	11875	3.0	7
		414	13659	2.6	6
25	30	250	8836	6.1	13
		380	13430	4.0	9
		510	18025	3.0	7
		604	21343	2.5	6
	32	250	9425	4.2	9
		365	13760	2.9	6
		485	18284	2.2	5
		566	21343	1.8	4
32	40	320	15080	2.3	5
		475	22384	1.5	3
		630	29688	1.2	3
		742	34956	1.0	2
40	50	400	21677	1.2	3
		565	30619	0.8	2
		730	39561	0.6	1
		900	48773	0.5	1

* : with 20% loss


6.3.6 - SPIT EPOBAR Resin - Class Concrete C45/55 ($f_{ck} = 45 \text{ Mpa}$)

Steel bar \varnothing (mm)	Drill hole \varnothing d_0 (mm)	Anchorage Length (mm) L_s	Ultimate limit load (daN)	No. of sealings for a 410 ml cartridge *	No. of sealings for a 910 ml cartridge *
8	10	100	1272	116	257
		110	1400	105	234
		145	1845	80	178
		172	2185	68	150
	12	100	1527	52	116
		100	1527	52	116
		125	1909	42	93
		143	2185	36	81
10	12	100	1527	95	211
		145	2214	65	145
		190	2901	50	111
		224	3415	42	94
	14	100	1781	44	97
		130	2316	33	74
		165	2939	26	59
		192	3415	23	50
12	15	120	2290	43	95
		170	3244	30	67
		220	4199	23	52
		258	4917	20	44
	18	120	2748	19	43
		150	3435	15	34
		190	4351	12	27
		215	4917	11	24
14	18	140	3206	23	52
		195	4466	17	37
		250	5726	13.1	29
		292	6693	11.2	25
	20	140	3563	15	32
		185	4708	11,1	25
		230	5853	8,9	20
		263	6693	7,8	17
16	20	160	4072	18	40
		225	5726	12,9	29
		290	7380	10,0	22
		344	8742	8,4	19
	24	160	4886	8,2	18
		205	6260	6,4	14
		250	7634	5,2	12
		286	8742	4,6	10
20	25	200	6362	9,3	21
		280	8906	6,6	15
		365	11610	5,1	11
		429	13659	4,3	10
	28	200	7125	5,4	12
		265	9441	4,1	9
		330	11756	3,3	7
		383	13659	2,8	6
25	30	250	9543	6,1	13
		360	13741	4,2	9
		470	17940	3,2	7
		559	21343	2,7	6
	32	250	10179	4,2	9
		350	14250	3,0	7
		450	18322	2,3	5
		524	21343	2,0	4
32	40	320	16286	2,3	5
		450	22902	1,6	4
		585	29773	1,2	3
		687	34956	1,1	2
40	50	400	23411	1,2	3
		565	33068	0,8	2
		730	42725	0,6	1
		900	52675	0,5	1

* : with 20% loss

7 – CONDITIONS OF USE

7.1 – Installation

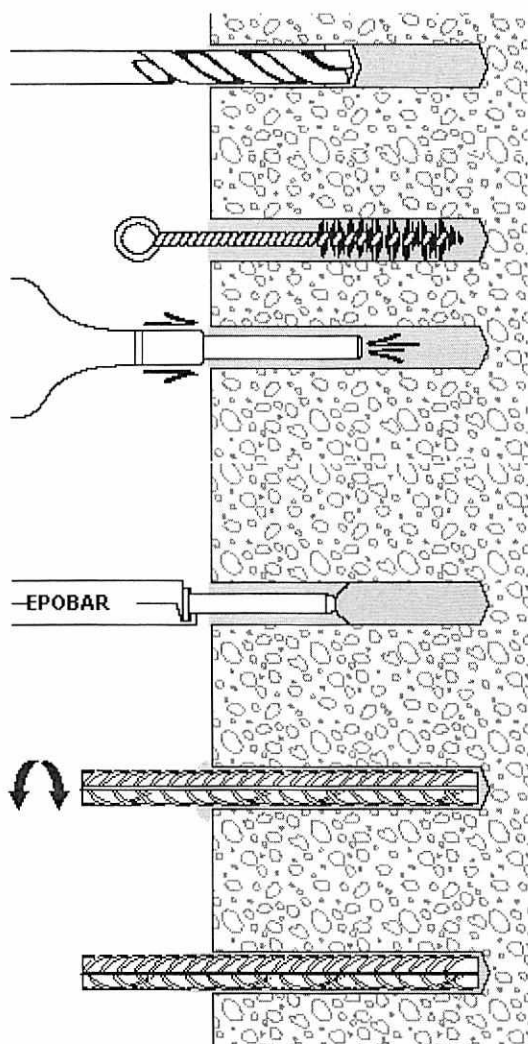

Drill a hole according to the diameter selected in the dimensioning tables of anchoring.

Remark : A hole can also be drilled with a diamond bit.

Clean the drilled hole with a metal cleaning brush.

Blow the dust out of the drilled hole.
The drilled hole may also be cleaned with pressurized water.

Inject from the bottom of the hole, progressively moving back until 50 % or more.

For an installation in a ceiling, we recommend using a washer at the nozzle end or an extension to guarantee a good filling in the drilled hole bottom.

Insert the rebar by hand in a twisting motion until the end of the hole is reached. The rod must be clean and free from oil and grease.

Check that the hole is well filled (no air bubbles present). An excess amount of the mixture must appear at the end of the anchoring.

Wait until resin to harden before applying the load (see table §7.2)

7.2 – Curing time before loading

The curing rate is dependent on the ambient temperature :

Ambient temperature (°C)	Maximum installing time (min)	Wait time before loading (min)
40	2	50 min.
30	4.5	65 min.
20	6.5	110 min.
10	10	3 h 10 min.
5	17	4 h 10 min.
0	26	5 h 15 min.
- 5	35	6 h 20 min.

8 – PRODUCTION AND QUALITY ASSURANCE

The EPOBAR resin is manufactured according to a control plan targeted at ensuring a regularity in quality. This control plan concerns the materials used, the cartridge filling and the products terminated. In addition, tests are systematically carried out in our laboratories.

It is registered, as well as the production drawings, at SOCOTEC, which can check at any moment that the plan is being applied. Each cartridge has an identification marking to allow a traceability back to the production batch.

Furthermore, we are responsible for informing SOCOTEC of any change involving the EPOBAR resin system.

An external control is conferred to SOCOTEC.

9 - VALIDITY

This approval granted by SOCOTEC is valid from the date of issue of this document until May 31, 2010.

APPENDIX 1 :

Chemical Substances	Concentration %	Resistance
Ethyl acetate	100	(-)
Acetone	10	(+)
Acetone	100	(-)
Acetic acid	50-75	(o)
Acetic acid	0-50	(+)
Hydrochloric acid	37	(-)
Hydrochloric acid	25	(o)
Hydrochloric acid	15	(+)
Hydrochloric acid and organic compounds		(-)
Citric acid	0-100	(+)
Formic acid	50	(-)
Formic acid	10	(+)
Lactic acid	0-100	(+)
Nitric acid	2-15	(o)
Nitric acid	50	(-)
Phosphoric acid	80	(+)
Concentrated phosphoric acid	100	(+)
Phosphoric acid, vapor and condensed		(+)
Sulfuric acid	71-75	(o)
Sulfuric acid	0-70	(+)
Sulfuric acid	Fumes	(+)
Sulfuric acid	76-93	(-)
Sulfuric acid / Phosphoric acid	10:20	(+)
Benzyl alcohol	0-100	(-)
Ethyl alcohol (Ethanol)	50	(-)
Ethyl alcohol (Ethanol)	10	(o)
Ammoniac, dry gas	0-100	(-)
Ammoniac, liquified	0-100	(-)

Chemical Substances	Concentration %	Resistance
Aniline	0-100	(-)
Benzene	100	(-)
Sodium carbonate	10	(+)
Diesel fuel	0-100	(+)
Sodium chloride	0-100	(+)
Bromine water	5	(+)
Chlorine water	0-100	(+)
Sea water	0-100	(+)
Deionized water	0-100	(+)
Demineralized water		(+)
Leaded or no-lead gasoline	100	(-)
Turpentine (oil)		(o)
Ethanolamine	100	(-)
Ethylene glycol	0-100	(+)
Fuel	100	(+)
Heptane	100	(+)
Hexane	100	(o)
Heavy motor oil	100	(+)
Ammonium hydroxide or Ammoniac	25	(-)
Ammonium hydroxide or Ammoniac	20	(o)
Ammonium hydroxide or Ammoniac	5	(+)
Sodium hydroxide (or Caustic soda)	25	(o)
Methyl isobutyl ketone	100	(-)
Ozone ()	Concent. < 4 ppm in water	(-)
Phenol	5	(-)
Carbon tetrachloride	100	(-)
Trichloroethylene		(-)
Xylene	0-100	(-)

▪ **Resistant (+)** : The samples in contact with the substance do not exhibit any visible damages such as cracks, attacked surfaces, exploded corners or major swellings.

▪ **Non resistant (-)** : Usage not recommended. The samples in contact with the substance were damaged.

▪ **Sensible (o)** : Usage with precautions with respect to exposure, usage field, applications to be redone. The samples in contact with the substance exhibit a slight attack on the material.